




DETAIL "A"  
CONSTRUCTION JOINT

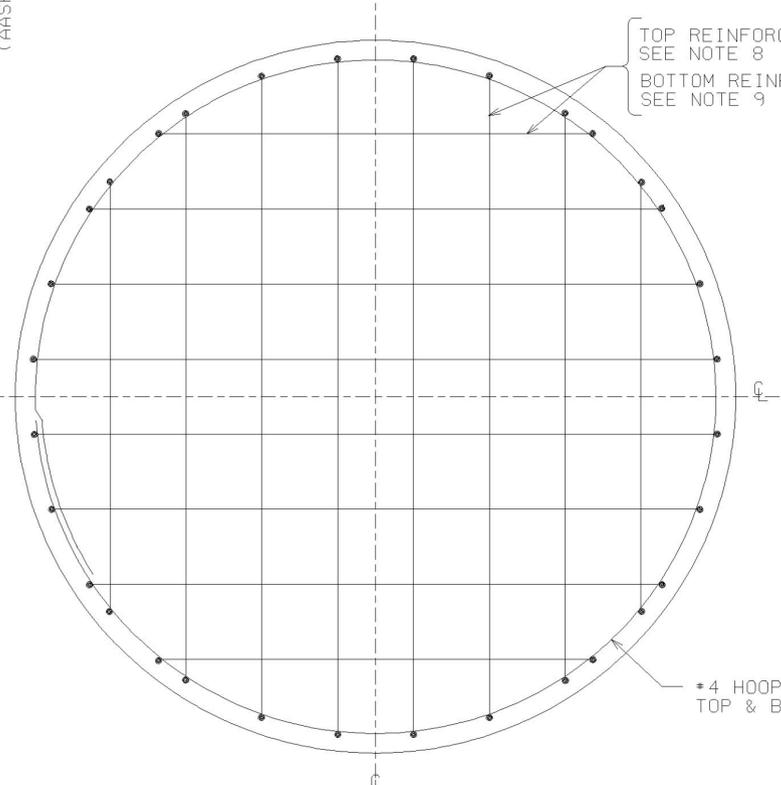


SECTION A-A

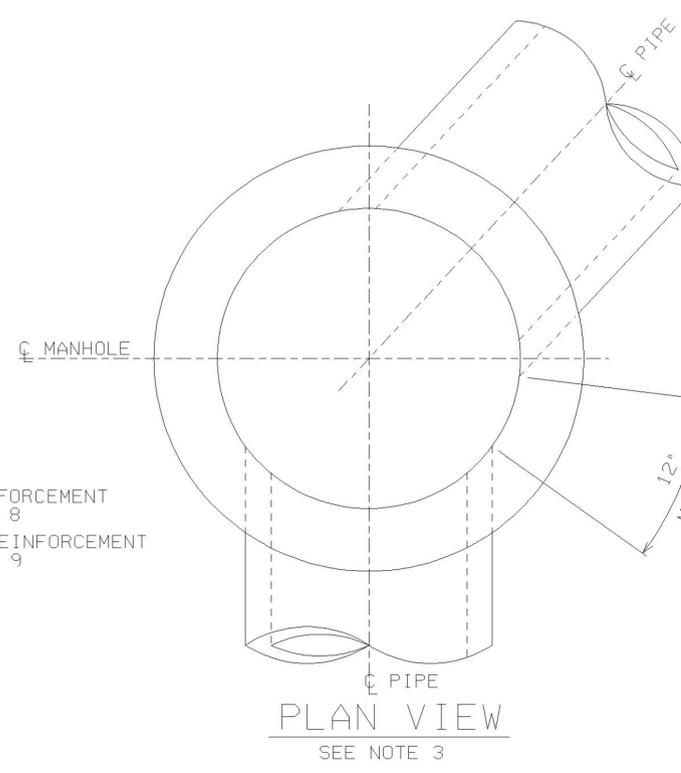

PLAN VIEW  
SEE NOTE 3

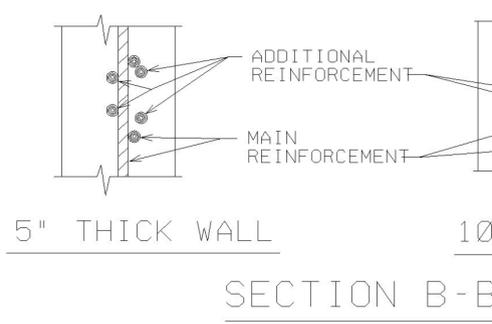

SECTION B-B

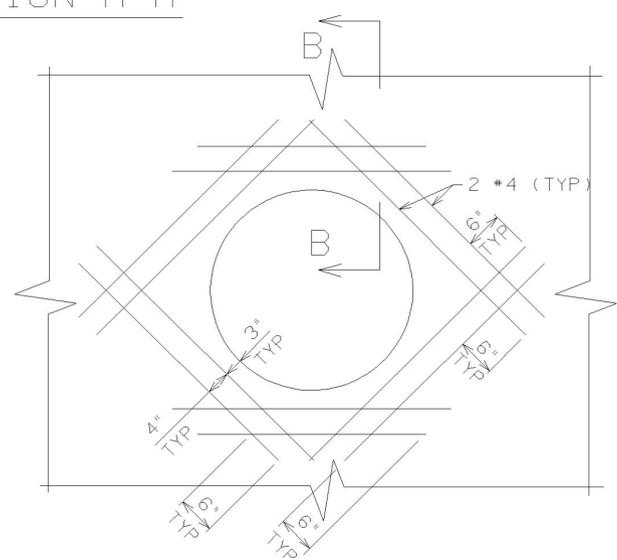

REINFORCEMENT DETAILS AT OPENINGS

NOTE: FOR WALL THICKNESSES 10" OR GREATER PLACE ADDITIONAL REINFORCEMENT AS SHOWN ABOVE AT EACH FACE OF THE WALL INSIDE MAIN REINFORCEMENT. FOR WALLS 5" THICK KEEP MAIN REINFORCEMENT CENTERED IN WALL. PROVIDE ADDITIONAL REINFORCEMENT AS SHOWN ABOVE, MAINTAINING REQUIRED COVER.

TABLE A  
BASE SLAB DIMENSIONS

MAX. DEPTH FROM TOP OF MANHOLE TO TOP OF FOOTING	AS DESIGNED FOOTING DIAMETER
10'-0"	6'-9"
20'-0"	6'-9"
30'-0"	6'-9"
40'-0"	7'-3"
50'-0"	8'-0"
60'-0"	8'-6"

CAST-IN-PLACE MANHOLE  
FOR PIPES 30 INCHES INSIDE DIAMETER AND LESS

FOR BASE SLAB DIMENSIONS SEE TABLE A

\$\$\$USERNAME\$\$\$  
\$\$\$DATE\$\$\$

REINFORCING BAR FAB. DETAIL
DESCRIPTION
REFERENCE